


FOR APPLICATIONS OVER NON-NAILABLE ROOF DECKS

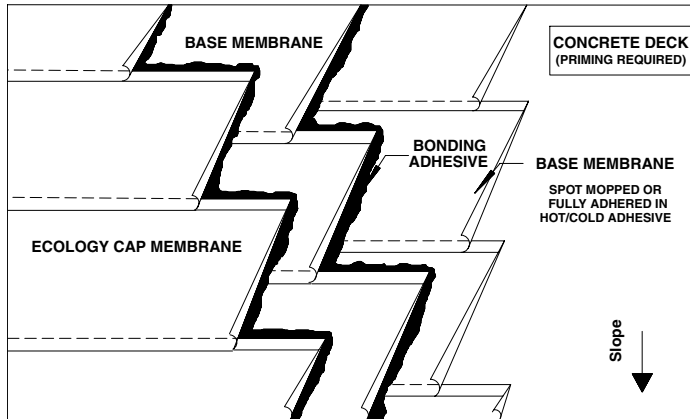

MATERIALS LIST AND MEMBRANE OPTIONS

Bonding Bitumen For Base Plies:

- ERS- All Temp: Steep Grade (Type III) ASTM D-312-84 at a minimum 25 lbs. per 100 SF.
- ERS-All Temp: Special Steep Grade (Type IV) ASTM D-312-84 at 25 lbs. per 100 SF.
- ERS Hot Flex: Modified Mopping Asphalt at 25 lbs. per 100 SF.

Primer:

- ERS-301 Quick Dry Asphalt Primer at 100 - 125 SF. per gallon.

Ecology Base Membrane Options (Select 2Plies):

- Asphalt Based: ERS-400, ERS-400-6, ERS-401
- SBS Based: ERS-500, ERS-500-4, ERS-500-6 or ERS-500-6P

Ecology Cap Membrane Options:

- SBS/SEBS: ERS-501, ERS-502, ERS-503, ERS-504, ERS-505, ERS-507, ERS-604, or ERS-703

Surfacing Options For Non-Granulated Sheets:

Ecology Coating	Membranes Accepted	Min. Coverage Rate
ERS-305:	All except ERS-501, ERS-503 & ERS-703	1-1/2 - 2 gal. per 100 SF.
ERS-308:	All except ERS-501, ERS-503 & ERS-703	1-1/2 - 2 gal. per 100 SF.
ERS-200:	All except ERS-703	3 gal. per 100 SF.
ERS-White Top:	All except ERS-501, ERS-503 & ERS-703	2 gal. per 100 SF.

Additional Surfacing Options For SBS:

- ERS All Temp: Hot Applied Asphalt at 60 - 70 lbs per 100 SF. with pea gravel embedded at the rate of approx. 400 lbs. per 100 SF.
- ERS Hot Flex: Hot Applied Rubberized Asphalt at 60 - 70 lbs per 100 SF. with pea gravel embedded at the rate of approx. 400 lbs. per 100 SF.
- ERS-302/ or 309: Cold Process Adhesive at 2 gallons per 100 SF. for mineral granules. At a minimum 5 gallons per 100 SF. for graveled surfaces.
- ERS Granules: Apply in wet adhesive to cover surface.
- Roofing Gravel: ASTM D1863 roofing aggregate at 400 lbs per 100 SF.

SPECIFICATION PROCEDURES

GENERAL:

This specification provides for the combined selection of two Ecology Base Ply Membranes and Ecology Cap Membrane directly over non-nailable (concrete type) decks. These specifications apply to positive slope roof systems with slopes up to 2", per the published design specifications of Ecology Roof Systems®. The substrate must be repaired, where damaged, if this specification is used for a replacement roof system. The NRCA deck dryness test should be performed prior to installing any materials. The substrate should be pre-primed with Ecology's ERS-301 which shall be dry before beginning the membrane installation. All rolls should be unrolled and relaxed prior to installation.

BASE MEMBRANES (MINIMUM 2 PLIES):

Install the first layer of selected Ecology Base Membrane by spot mop application of hot asphalt or fully adhering the membrane in cold process adhesive membrane in accordance with Ecology's approved procedures. For mop applications, where the maximum slope is 1/2" in 12", Type III asphalt can be used. Where the slope is over 1/2", Type IV asphalt should be used.

Begin by starting at the low point in the roof, laying a 12" starter sheet of base membrane followed by full width layers applied in shingle fashion, perpendicular to the slope, with 2" side laps and 4" end laps, or as marked and required for selected membrane. All end laps should be staggered no less than 3' apart.

The second layer of base membrane shall be installed with hot mop or cold process adhesive application depending on the type of membrane selected. Beginning at the low point, a 24" starter membrane should be installed, followed by full width layers applied in shingle fashion, perpendicular to the slope, using 2" side laps and 4" end laps, or as marked and required for selected membrane. All end laps shall be staggered no less than 3' apart.

NOTE: If application of the base sheets is by means of cold process adhesive, ERS-400, ERS-400-6, and ERS-500 should not be used.

CAP MEMBRANE:

Install the Ecology membrane with hot applied asphalt or cold process adhesive beginning at the low point on the roof running parallel to the installed base membrane. Stagger the side and end laps of the cap membrane a minimum of 9" from the side and end laps of the base membrane. Mop systems should be rolled immediately into the hot asphalt with asphalt temperatures maintained at 400°F at the point of application. Mopping should proceed the roll no more than 3' with side laps mopped last. A uniform flow of bitumen of about 1/4" should be around all seams. Unless otherwise marked, side laps on the Ecology membranes shall be a minimum of 4" and end laps a minimum of 8". Cold process applications should have adhesive held back from the laps for welding with a hot air welder. Mopped applications may also have laps welded with hot air. For slopes of 1" - 2" per lineal foot, apply material parallel to the slope with head laps back-nailed 6" on center approximately 2" in from the edge. Stagger end laps a minimum of 36" from ends of the previous roll. Follow Ecology's published installation procedures for more detailed instructions.

SURFACING:

All smooth surface membranes must receive surface protection. Factory finished mineral and metal surface membranes do not require any additional protection, but mineral surfaces can be coated, if desired, using higher coverage rates for the rougher membrane surface. Follow application procedures outlined by Ecology Roof Systems® regarding preparation and dry time required. Smooth surfaced SBS membranes, after a 30 day curing process, may be coated with one of the Ecology reflective coatings or can be surfaced with one of Ecology's hot applied asphalt blends with graded roofing aggregate embedded. The membranes may also be surfaced with an Ecology cold process adhesive with mineral granules embedded to cover the adhesive.

